



J:\1-06229 - Roundup\CADD_1-06229-TO_14-PER\Exhibits\1-06229-Water_Main_Progress_Figure-2015.dwg



LEGEND


- 4" PVC w — EXISTING WATER LINE, TYPE, SIZE
- 4" CI w — ABANDONED WATER LINE, TYPE, SIZE
- EXISTING FIRE HYDRANT
- EXISTING SERVICEABLE VALVE
- EXISTING NON-SERVICEABLE VALVE

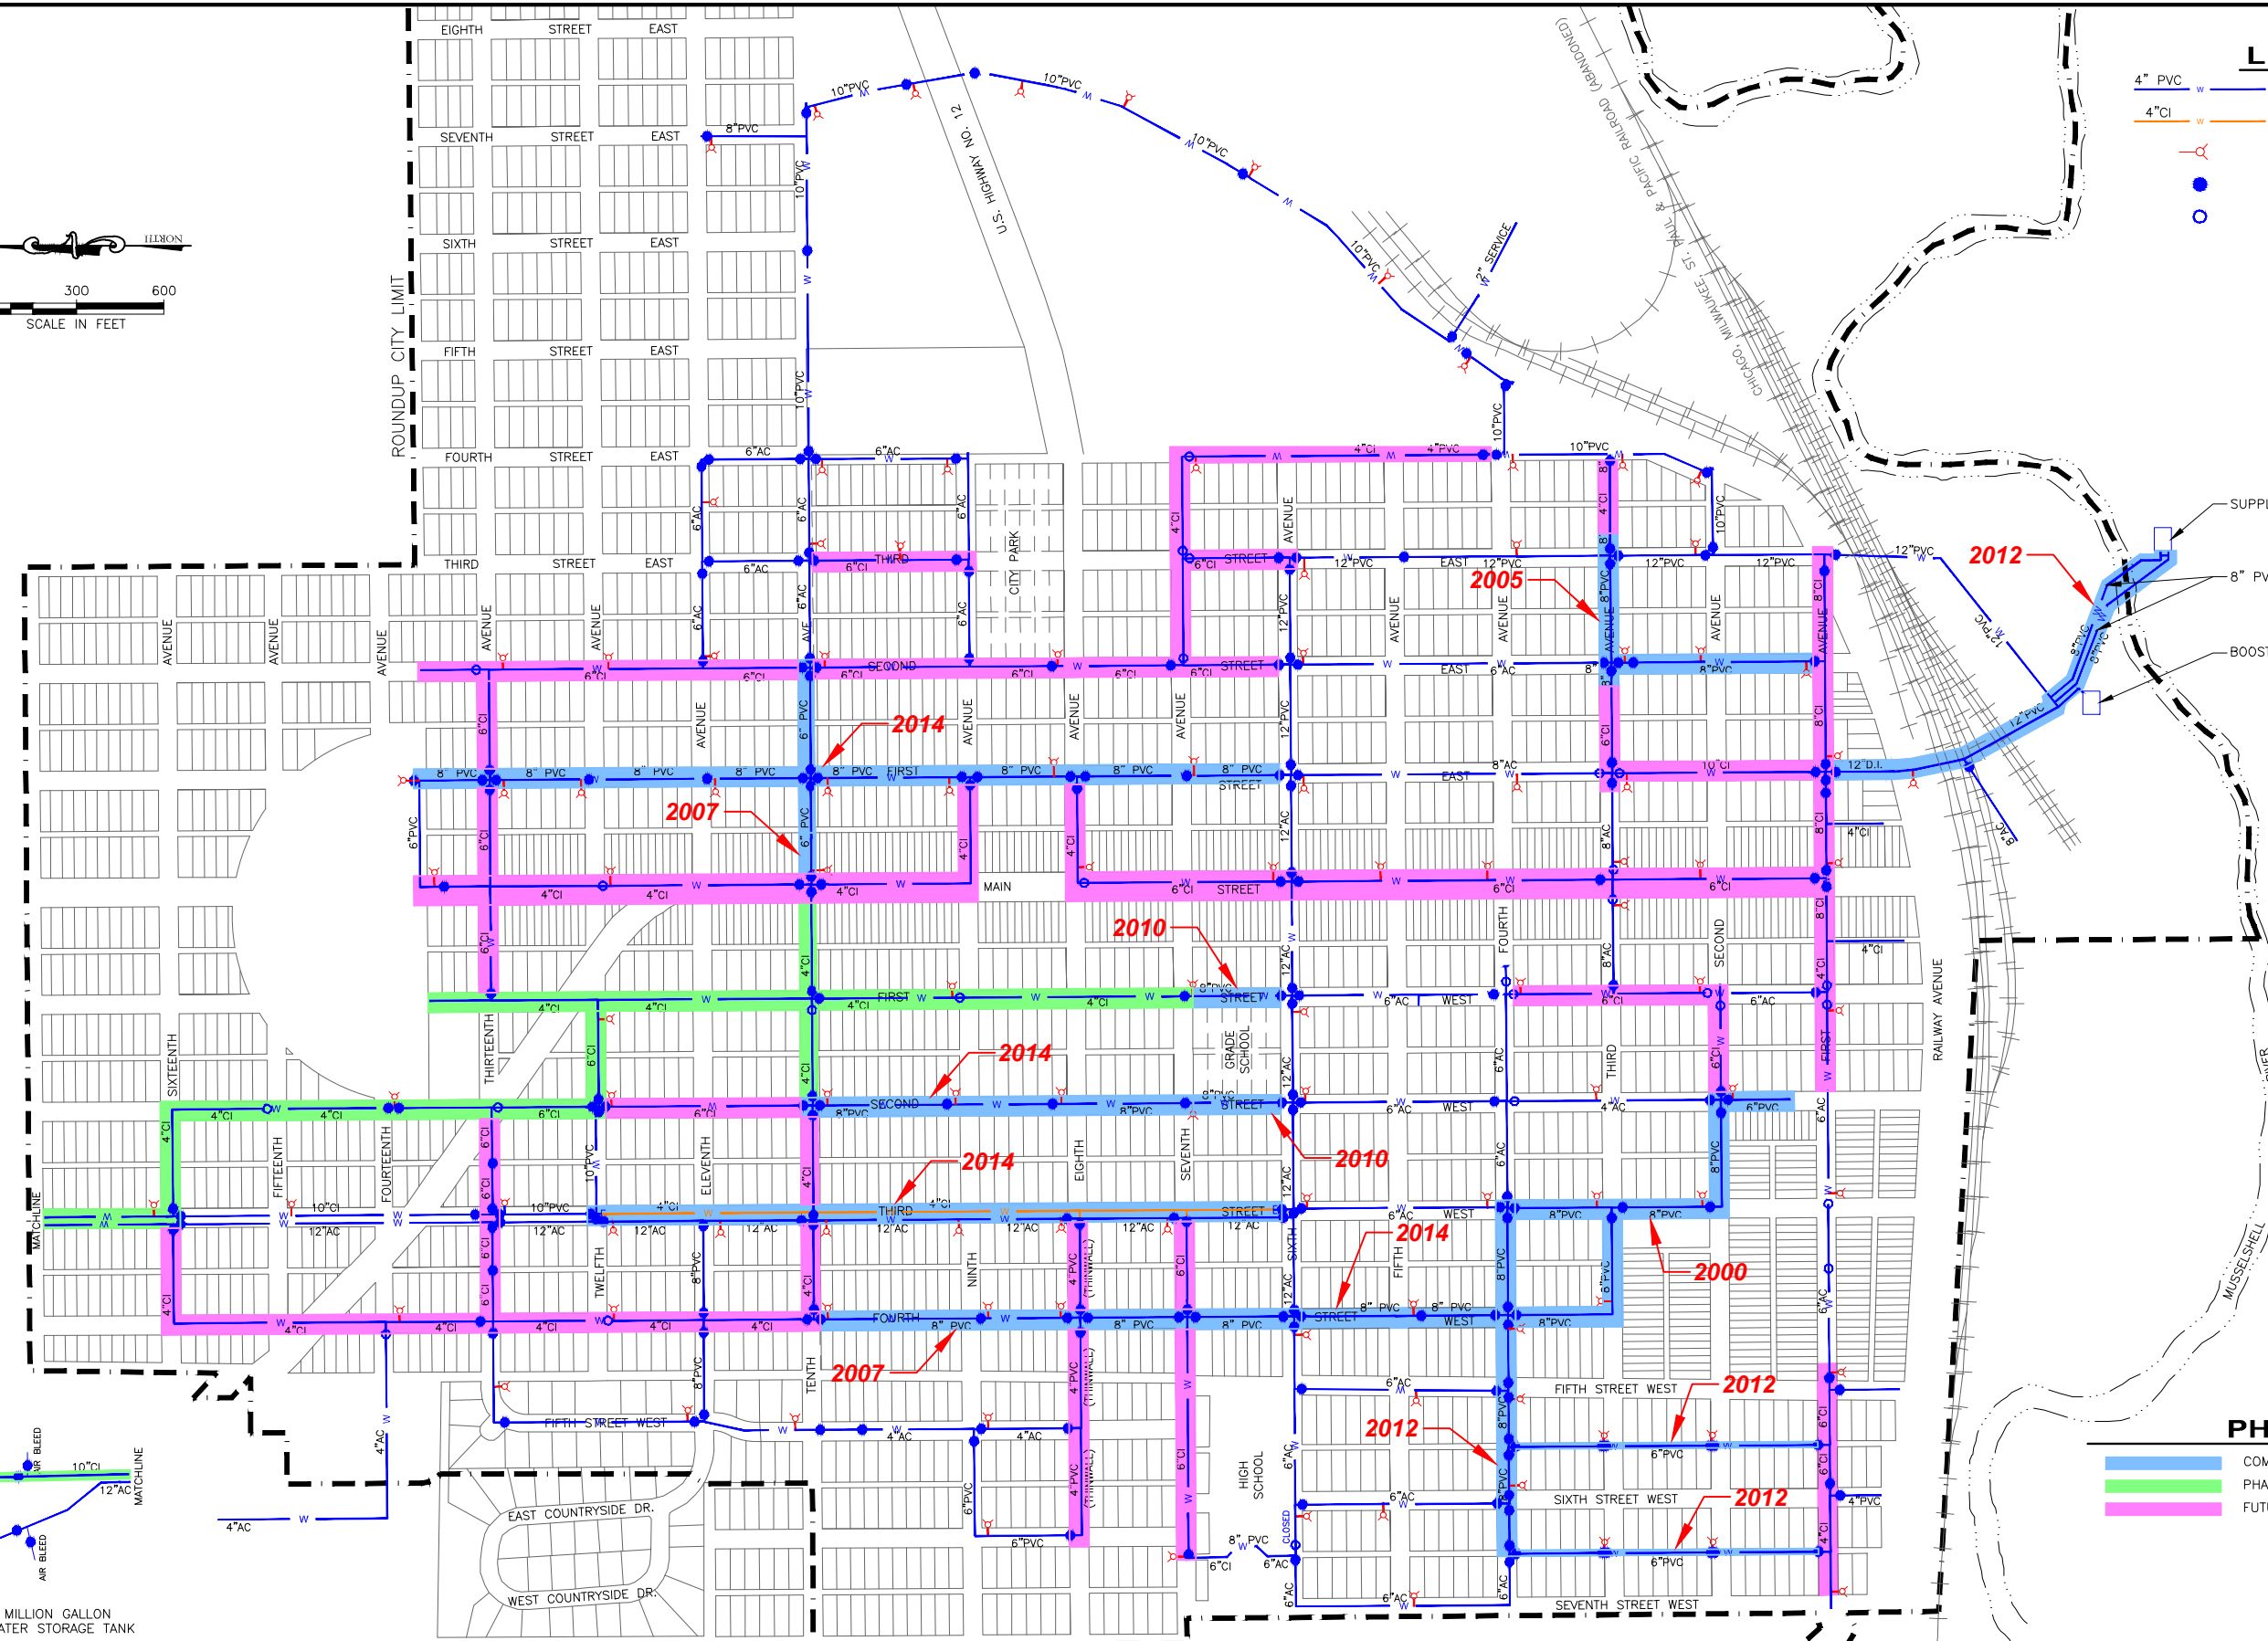

- SUPPLY WELLS
- 8" PVC TRANSMISSION MAIN
- BOOSTER STATION/CLEARWELL

PHASING

- COMPLETED PHASES
- PHASE 3: TO BE COMPLETED IN 2016
- FUTURE PHASES BEYOND 2016

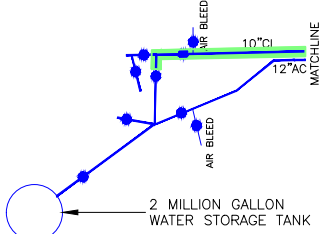

**Figure 1-2:
Phase 3A and 3B Rehabilitation**

